
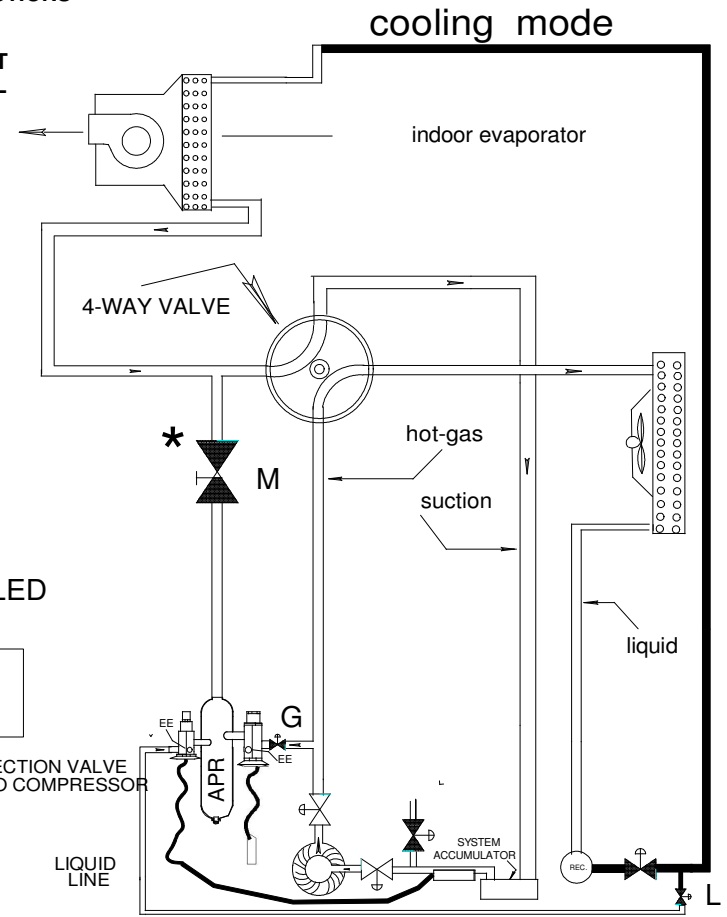


SINGLE EVAPORATOR HEAT-PUMP SYSTEM

PLEASE READ ALL INSTALLATION INSTRUCTIONS
BEFORE STARTING INSTALLATION

APR CONTROL IN DIAGRAM MAY REFLECT
DIFFERENT CONNECTIONS FROM ACTUAL

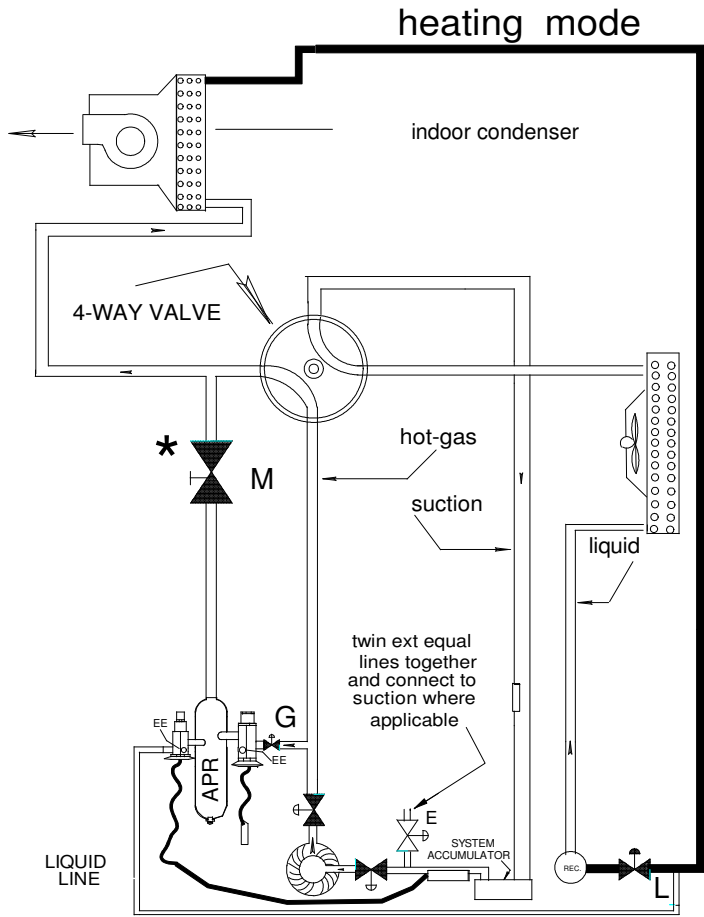

* LINE VALVES M-EE-G-L TO BE
FIELD SUPPLIED and INSTALLED

APR CONTROL ACTIVE
IN COOLING MODE ONLY

BULB FROM LIQ. INJECTION VALVE
TO SUCTION LINE INTO COMPRESSOR

Tel. 800-727-6447
Fax 781-933-3306

RAWAL DEVICES, INC.

sales@rawal.com
www.rawal.com