


APR CONTROL® FOR R-410A IN TANDEM COMPRESSOR CONFIGURATION

Heat Pump(HP) Installation will be different.
See HP installation diagram

Read all installation instructions before installing

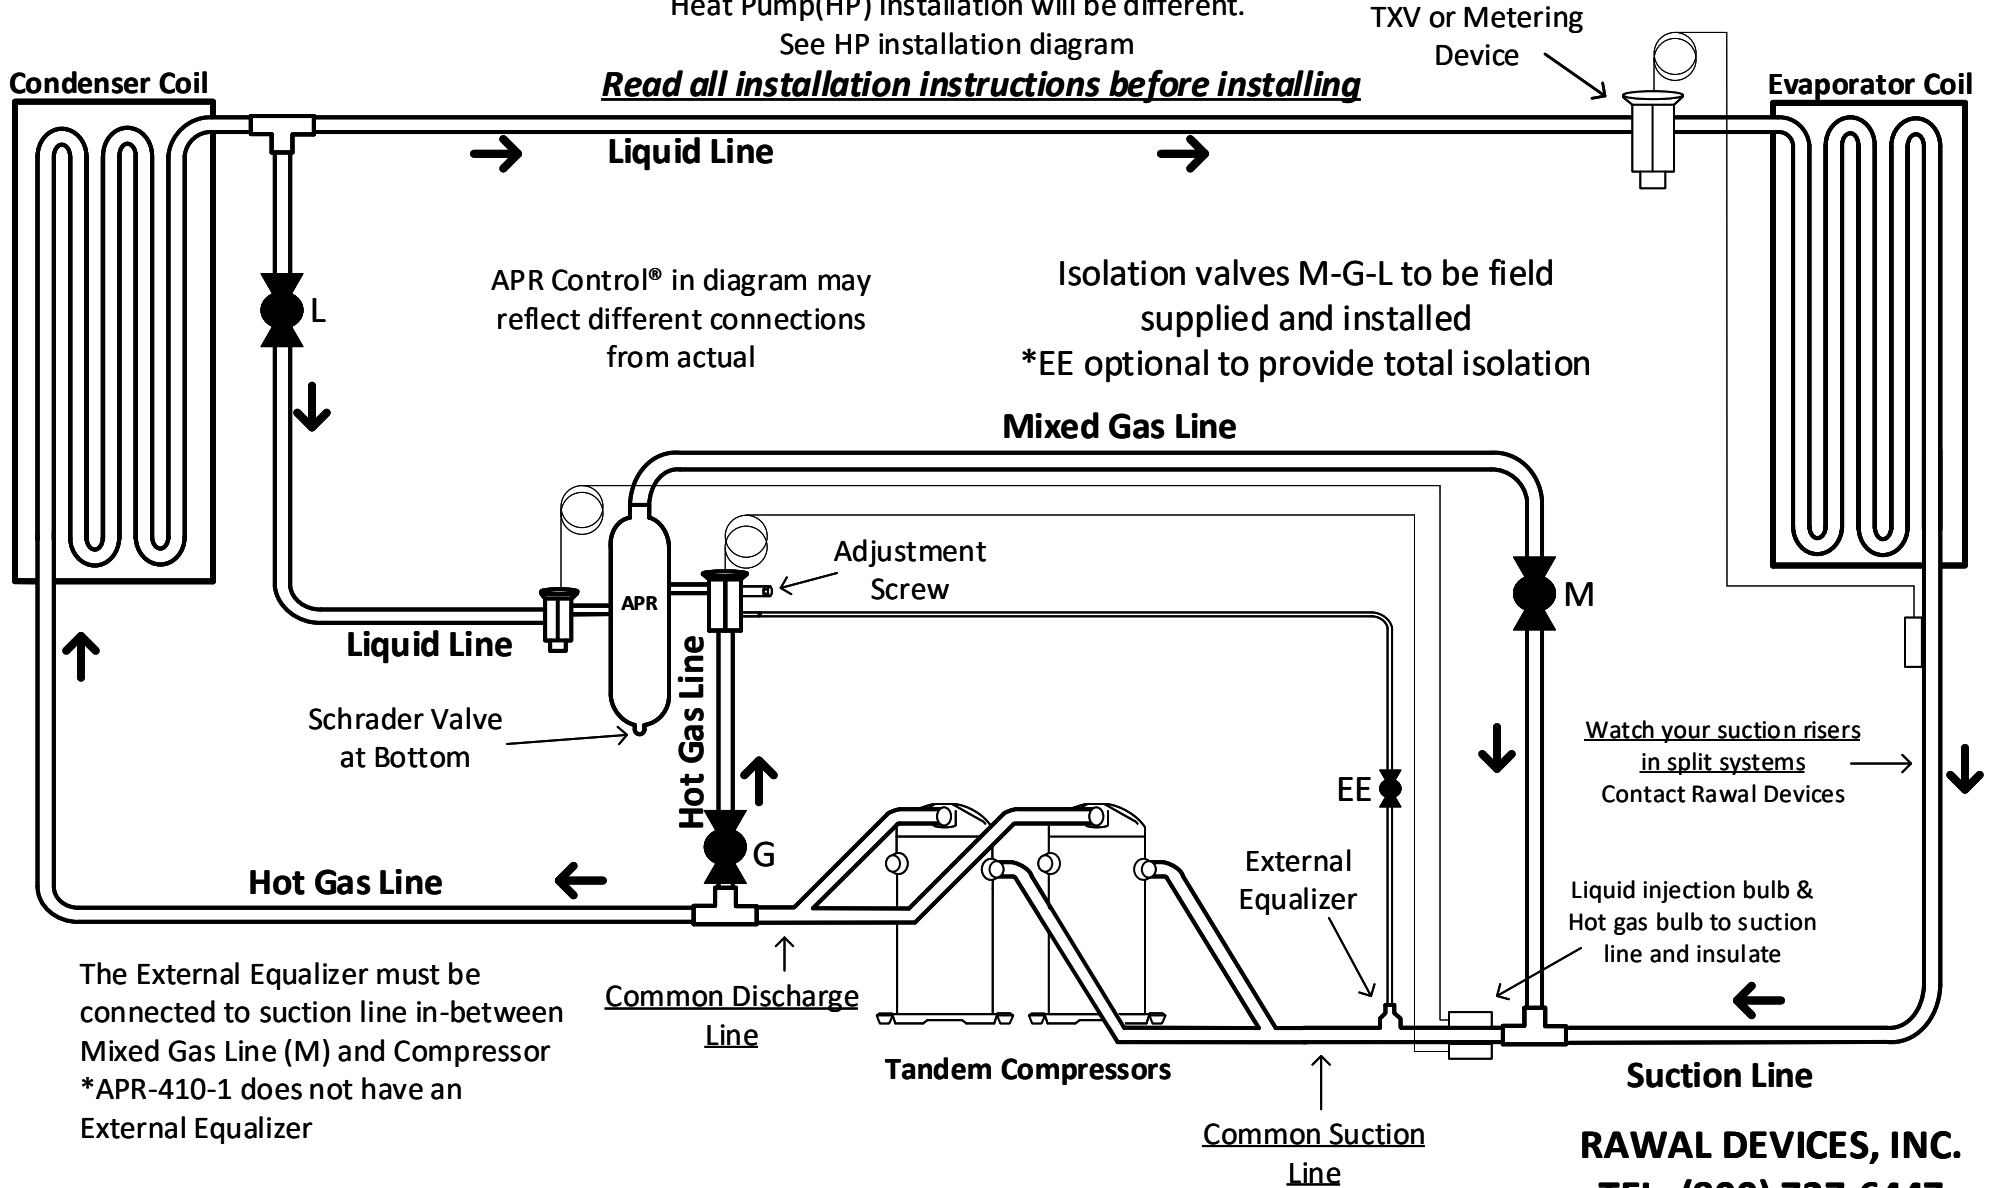

APR Control® in diagram may reflect different connections from actual

Isolation valves M-G-L to be field supplied and installed
*EE optional to provide total isolation

Mixed Gas Line

Watch your suction risers in split systems
Contact Rawal Devices

Liquid injection bulb & Hot gas bulb to suction line and insulate

The External Equalizer must be connected to suction line in-between Mixed Gas Line (M) and Compressor
*APR-410-1 does not have an External Equalizer



RAWAL DEVICES, INC.
TEL. (800) 727-6447
www.Rawal.com
techsupport@rawal.com

*Drawing for illustrative purposes only
Please call for assistance



APR CONTROL® FOR R-410A IN A HEAT PUMP SYSTEM

Read all installation instructions before installing

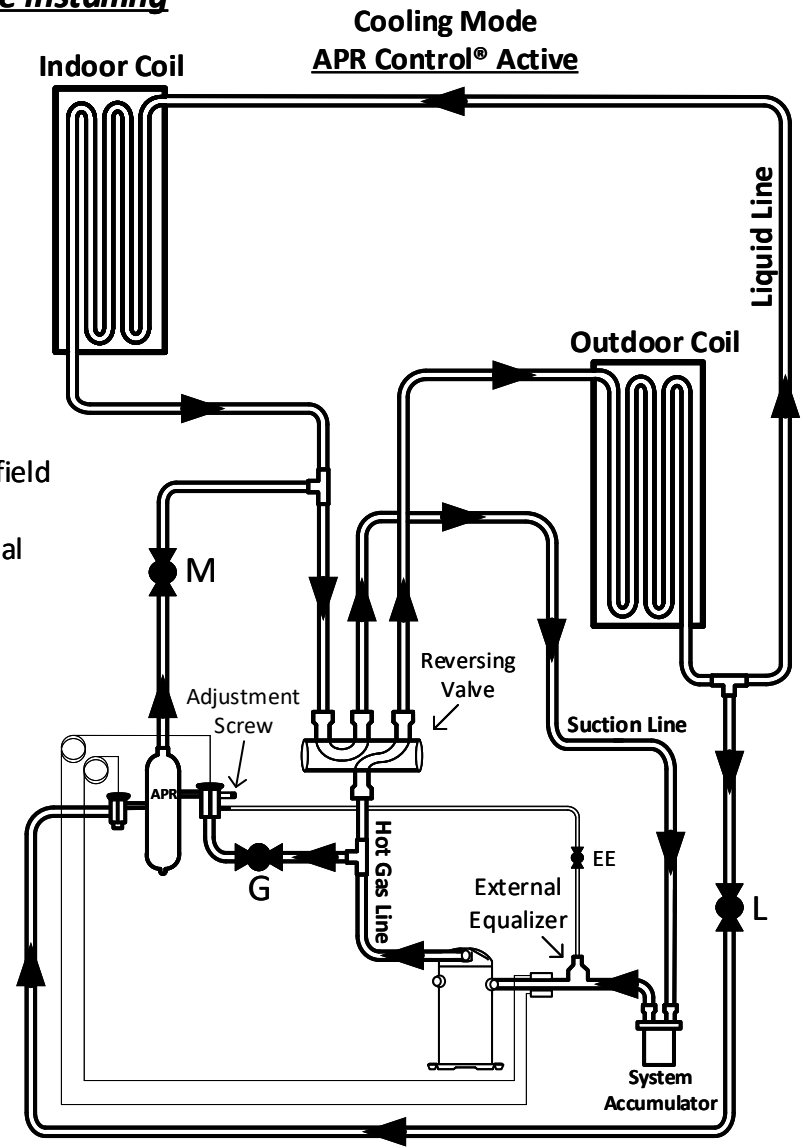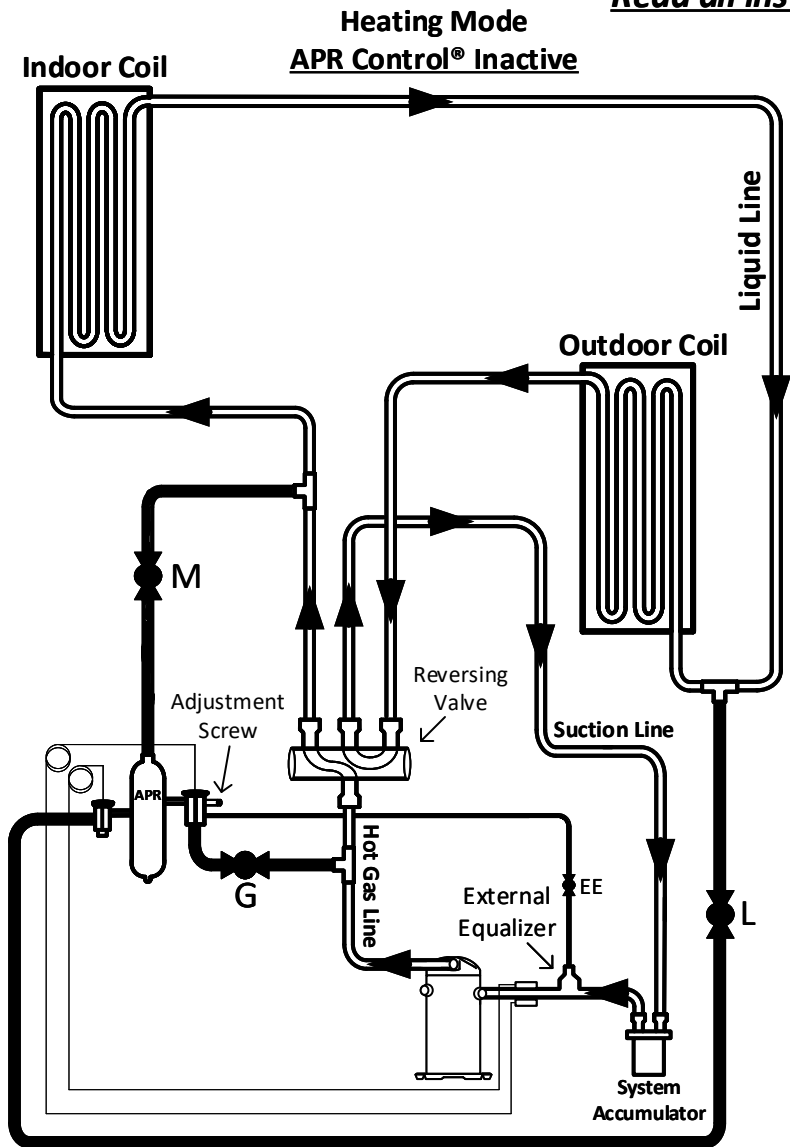

Isolation valves M-G-L to be field supplied and installed
*EE optional to provide total isolation

APR Control® active in cooling mode only

RAWAL DEVICES, INC.

TEL. (800) 727-6447

www.Rawal.com

techsupport@rawal.com

*Drawing for illustrative purposes only
Please call for assistance

